


October 16, 2025 - 3:13pm T:\Projects\2025\25-015 - ACM College Center Chiller Drawings\25-015 - H0.5.dwg



CHILLED AND CONDENSER WATER SCHEMATIC FLOW DIAGRAM - HVAC
NOT TO SCALE

COORDINATE ALL REQUIRED SENSORS WITH SEQUENCE OF CONTROLS - SEE SPECIFICATION

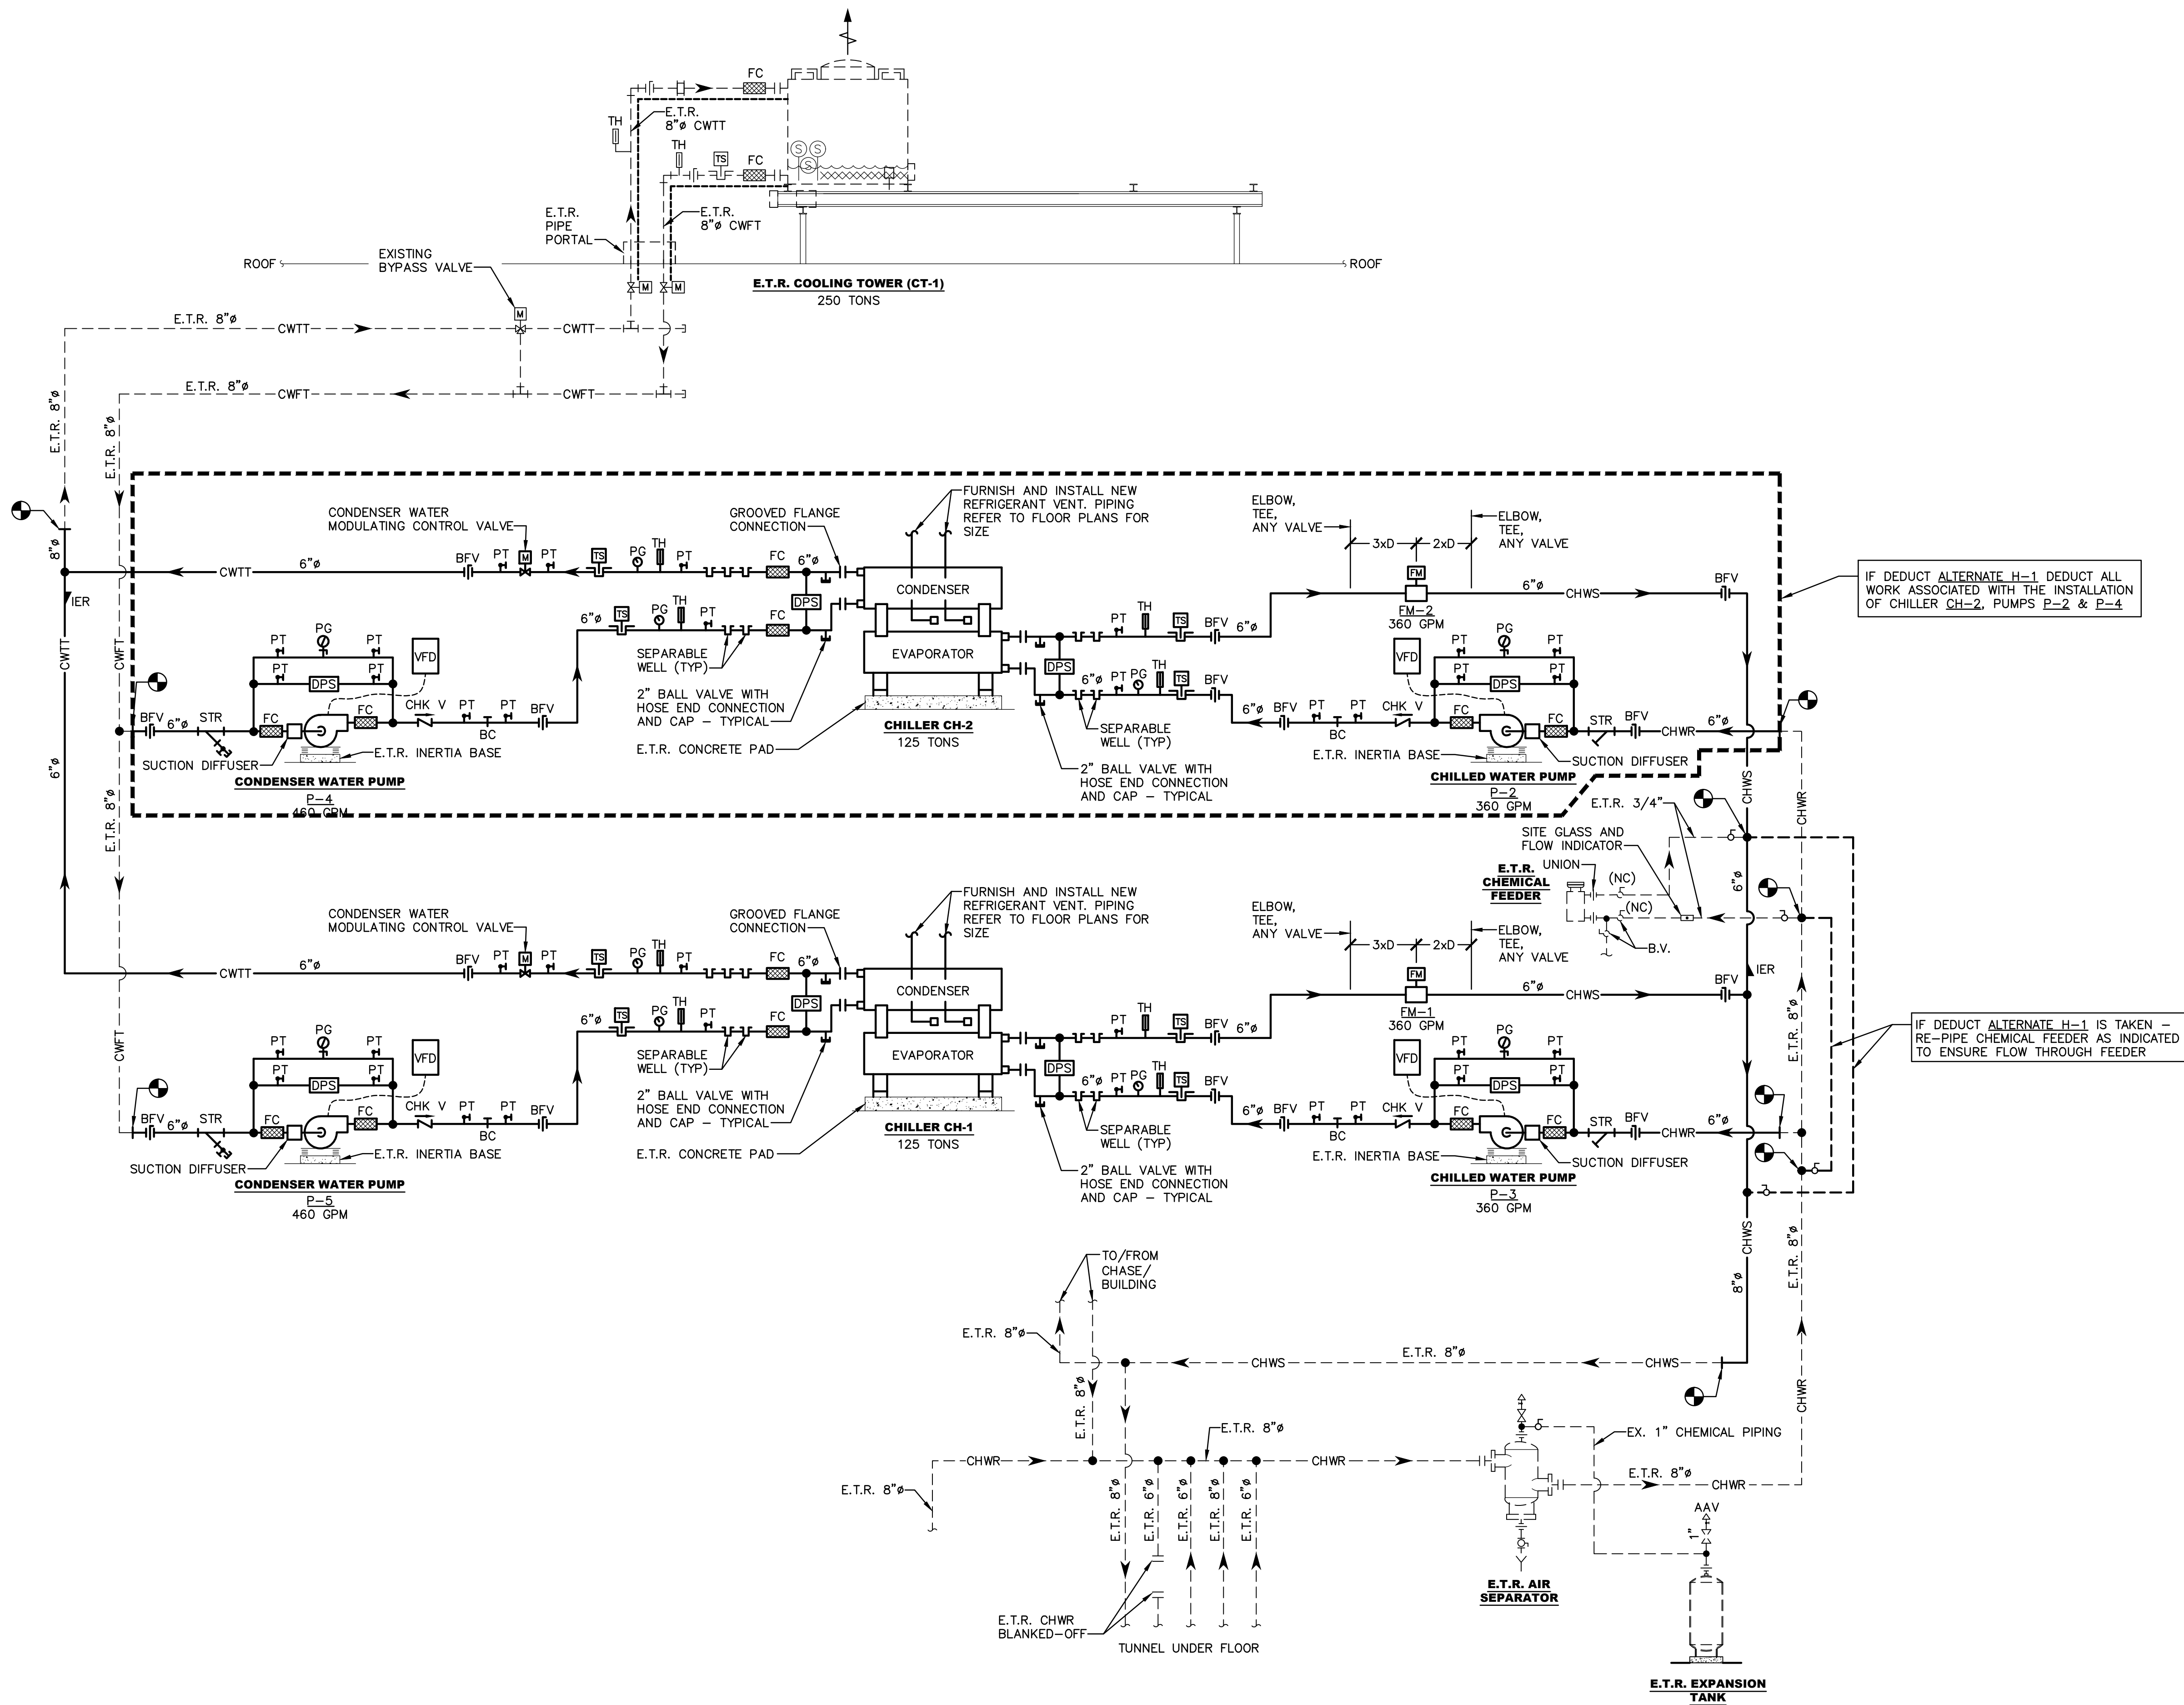

PROFESSIONAL CERTIFICATION
I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 10701, EXPIRATION DATE: 10/17/2025.
CHRISTOPHER G. ALBRIGHT DATE 10/17/2025

CHILLED WATER SCHEMATIC - HVAC

CHILLER REPLACEMENT
COLLEGE CENTER
FOR
ALEGANY COMMUNITY COLLEGE
WILLOWBROOK ROAD, CUMBERLAND, MD 21502



BRETT N. YONISH, P.E.
CHRISTOPHER G. ALBRIGHT, P.E.

541 MAIN STREET
WINDBER, PA 15963
(814) 467-6877

REVISIONS		
MARK	BY	DATE

DATE: 10-17-2025	DRAWING NO. H0.5
DRAWN BY: C. G. A.	
CHECKED BY: C. G. A.	
PROJECT NO. 25-015	